


Insulated multi-pole splicing wire connectors

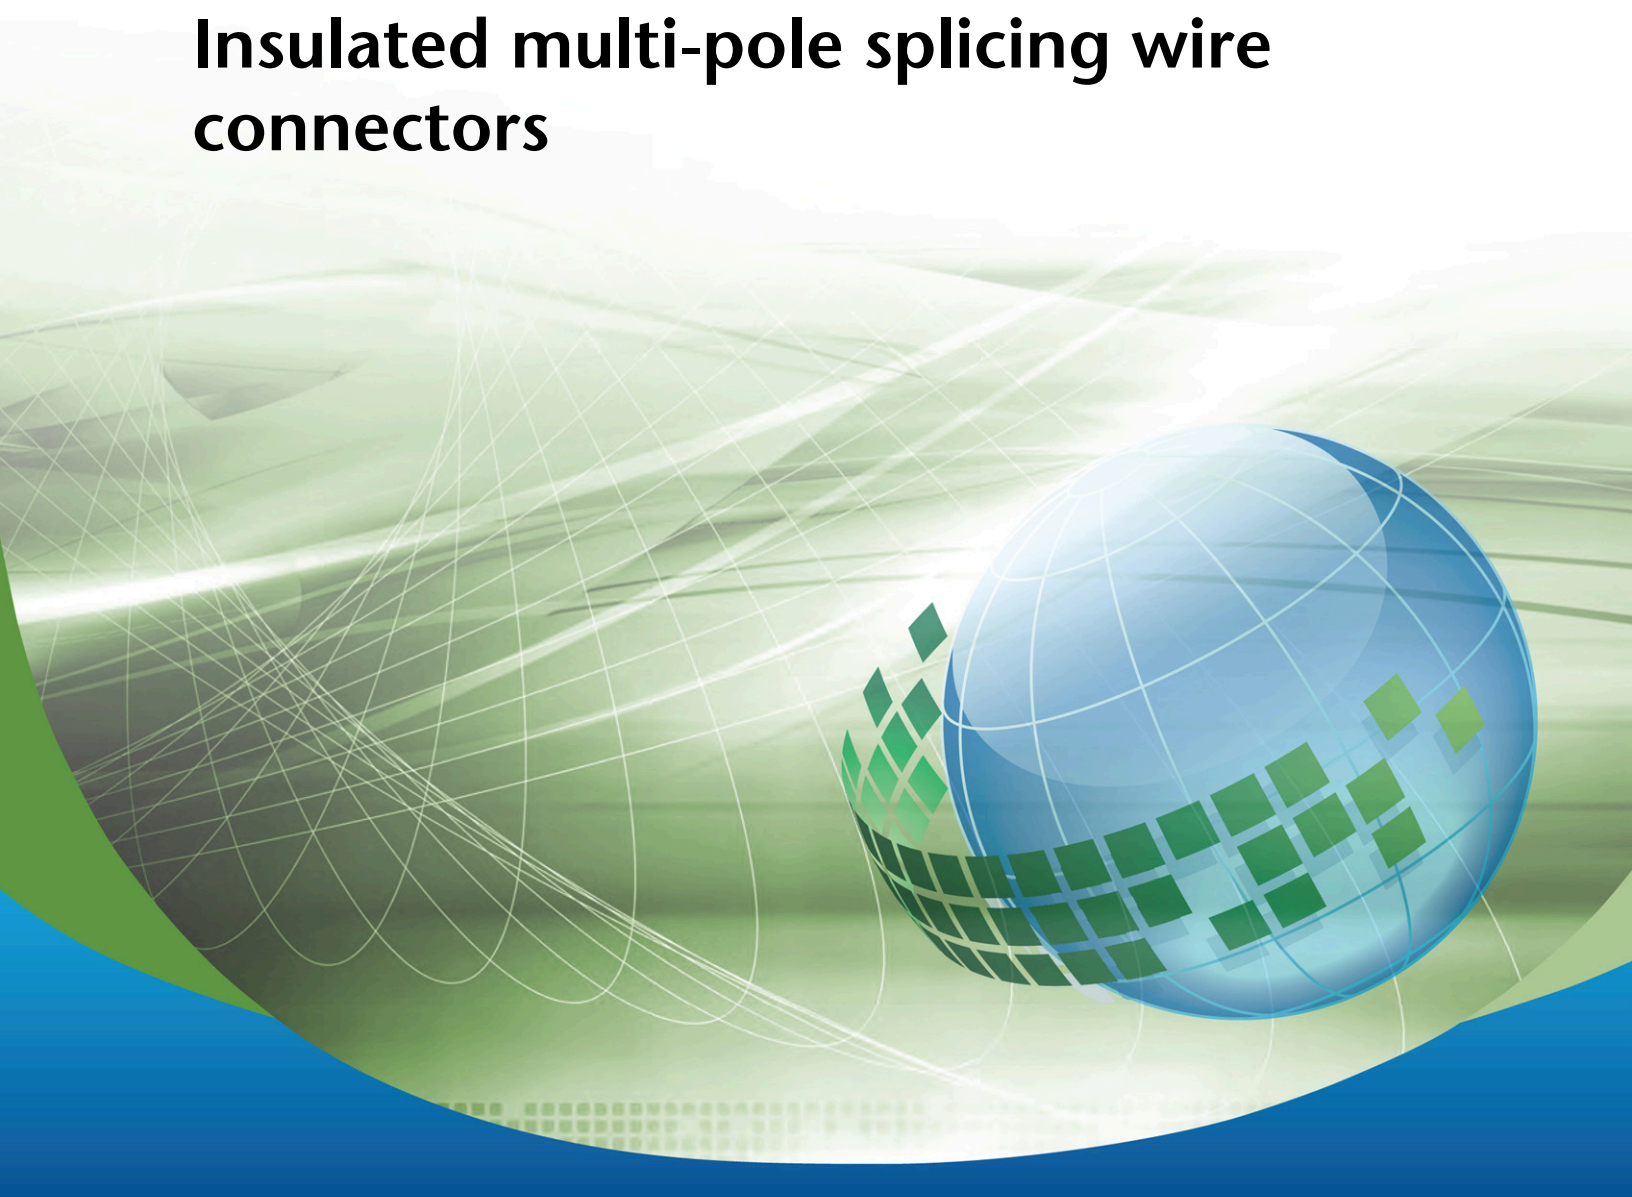

Legal Notice for Standards

Canadian Standards Association (CSA) standards are developed through a consensus standards development process approved by the Standards Council of Canada. This process brings together volunteers representing varied viewpoints and interests to achieve consensus and develop a standard. Although CSA administers the process and establishes rules to promote fairness in achieving consensus, it does not independently test, evaluate, or verify the content of standards.

Disclaimer and exclusion of liability

This document is provided without any representations, warranties, or conditions of any kind, express or implied, including, without limitation, implied warranties or conditions concerning this document's fitness for a particular purpose or use, its merchantability, or its non-infringement of any third party's intellectual property rights. CSA does not warrant the accuracy, completeness, or currency of any of the information published in this document. CSA makes no representations or warranties regarding this document's compliance with any applicable statute, rule, or regulation.

IN NO EVENT SHALL CSA, ITS VOLUNTEERS, MEMBERS, SUBSIDIARIES, OR AFFILIATED COMPANIES, OR THEIR EMPLOYEES, DIRECTORS, OR OFFICERS, BE LIABLE FOR ANY DIRECT, INDIRECT, OR INCIDENTAL DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES, HOWSOEVER CAUSED, INCLUDING BUT NOT LIMITED TO SPECIAL OR CONSEQUENTIAL DAMAGES, LOST REVENUE, BUSINESS INTERRUPTION, LOST OR DAMAGED DATA, OR ANY OTHER COMMERCIAL OR ECONOMIC LOSS, WHETHER BASED IN CONTRACT, TORT (INCLUDING NEGLIGENCE), OR ANY OTHER THEORY OF LIABILITY, ARISING OUT OF OR RESULTING FROM ACCESS TO OR POSSESSION OR USE OF THIS DOCUMENT, EVEN IF CSA HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES.

In publishing and making this document available, CSA is not undertaking to render professional or other services for or on behalf of any person or entity or to perform any duty owed by any person or entity to another person or entity. The information in this document is directed to those who have the appropriate degree of experience to use and apply its contents, and CSA accepts no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained in this document.

CSA is a private not-for-profit company that publishes voluntary standards and related documents. CSA has no power, nor does it undertake, to enforce compliance with the contents of the standards or other documents it publishes.

Intellectual property rights and ownership

As between CSA and the users of this document (whether it be in printed or electronic form), CSA is the owner, or the authorized licensee, of all works contained herein that are protected by copyright, all trade-marks (except as otherwise noted to the contrary), and all inventions and trade secrets that may be contained in this document, whether or not such inventions and trade secrets are protected by patents and applications for patents. Without limitation, the unauthorized use, modification, copying, or disclosure of this document may violate laws that protect CSA's and/or others' intellectual property and may give rise to a right in CSA and/or others to seek legal redress for such use, modification, copying, or disclosure. To the extent permitted by licence or by law, CSA reserves all intellectual property rights in this document.

Patent rights

Attention is drawn to the possibility that some of the elements of this standard may be the subject of patent rights. CSA shall not be held responsible for identifying any or all such patent rights. Users of this standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.

Authorized use of this document

This document is being provided by CSA for informational and non-commercial use only. The user of this document is authorized to do only the following:

If this document is in electronic form:

- load this document onto a computer for the sole purpose of reviewing it;
- search and browse this document; and
- print this document if it is in PDF format.

Limited copies of this document in print or paper form may be distributed only to persons who are authorized by CSA to have such copies, and only if this Legal Notice appears on each such copy.

In addition, users may not and may not permit others to

- alter this document in any way or remove this Legal Notice from the attached standard;
- sell this document without authorization from CSA; or
- make an electronic copy of this document.

If you do not agree with any of the terms and conditions contained in this Legal Notice, you may not load or use this document or make any copies of the contents hereof, and if you do make such copies, you are required to destroy them immediately. Use of this document constitutes your acceptance of the terms and conditions of this Legal Notice.



This is a preview. [Click here to purchase the full publication.](#)

Update No. 2

C22.2 No. 2459-08

September 2018

Note: For information about the **Standards Update Service** or if you are missing any updates, go to **shop.csa.ca** or e-mail **techsupport@csagroup.org**.

Title: *Insulated multi-pole splicing wire connectors* — originally published August 2008

Revisions issued: Update No. 1 — February 2014

The following revisions have been formally approved and are marked by a vertical line in the margin on the attached replacement pages:

Revised	Cover, copyright page, Preface, and Clauses 1.3 and 4.4.1
New	Clauses 1.2A and C.1 and Table 4
Deleted	Tables 4A and 4B

- Update your copy by inserting these revised pages.
- Keep the pages you remove for reference.

First Edition, Dated August 22, 2008

Summary of Topics

This revision of includes the following changes in requirements:

Minimum Spacings Table 4

Intermateability of Connectors

Use of Multi-Pole Splicing Wire Connectors as Disconnects in LED Applications



Canadian Standards Association
CSA C22.2 No. 2459-08
First Edition



Underwriters Laboratories Inc.
UL 2459
First Edition

Insulated Multi-Pole Splicing Wire Connectors

August 22, 2008

(Title Page Reprinted: September 20, 2018)



ANSI/UL 2459-2018

This is a preview. [Click here to purchase the full publication.](#)

Commitment for Amendments

This standard is issued jointly by the Canadian Standards Association (operating as “CSA Group”) and Underwriters Laboratories Inc. (UL). Comments or proposals for revisions on any part of the standard may be submitted to CSA Group or UL at anytime. Revisions to this standard will be made only after processing according to the standards development procedures of CSA Group and UL. CSA Group and UL will issue revisions to this standard by means of a new edition or revised or additional pages bearing their date of issue.

ISBN 1-55436-435-3 © 2008 Canadian Standards Association

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

This Standard is subject to review within five years from the date of publication, and suggestions for its improvement will be referred to the appropriate committee. To submit a proposal for change, please send the following information to inquires@csagroup.org and include “Proposal for change” in the subject line: Standard designation (number); relevant clause, table, and/or figure number; wording of the proposed change; and rationale for the change.

To purchase CSA Group Standards and related publications, visit CSA Group’s Online Store at shop.csa.ca or call toll-free 1-800-463-6727 or 416-747-4044.

Copyright © 2018 Underwriters Laboratories Inc.

UL’s Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL’s Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

This ANSI/UL Standard for Safety consists of the First edition including revisions through September 20, 2018. The most recent designation of ANSI/UL 2459 as an American National Standard (ANSI) occurred on September 20, 2018. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, Title Page (front and back), or the Preface.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL’s On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

To purchase UL Standards, visit UL’s Standards Sales Site at <http://www.shopulstandards.com/HowToOrder.aspx> or call toll-free 1-888-853-3503.

CONTENTS

Preface	5
1 Scope	6A
2 Reference publications and definitions	8
2.1 Reference publications	8
2.2 Definitions	9
3 Units of measurement	11
4 Construction	11
4.1 General	11
4.2 Materials	12
4.3 Accessibility of parts	14
4.4 Spacings	15
4.5 Mating-type (separable-type) connectors	16
4.6 Integral pigtail leads	16
5 Test requirements	16
5.1 General	16
5.2 Grounding contact – Short-time withstand current	17
5.3 Latching mechanism	17
5.4 Abnormal overload	18
5.5 Temperature	18
5.6 Dielectric voltage withstand	18
5.7 Dielectric withstand – Puncture	19
5.8 Mold stress relief	19
5.9 Current cycling	20
5.10 Mechanical sequence	21
5.11 Stress corrosion/moist ammonia (NH ₄)	21
5.12 Stress corrosion/mercurous nitrate (HgNO ₃)	21
5.13 Spring action	21
6 Sampling requirements	21
7 Test methods	22
7.1 General	22
7.2 Grounding contact – Short-time withstand current	28
7.3 Latching or locking mechanism	29
7.4 Abnormal overload	29
7.5 Temperature rise	30
7.6 Dielectric voltage withstand	31
7.7 Dielectric withstand – Puncture	31
7.8 Mold stress relief	32
7.9 Current cycling	32
7.10 Mechanical sequence	33
7.11 Stress corrosion/moist ammonia (NH ₄)	34
7.12 Stress corrosion/mercurous nitrate (HgNO ₃)	35
7.13 Spring-action sequence	35
8 Marking, labelling, and packaging	36
TABLES	39
FIGURES	47

Annex A (Informative)

A.1 Example of a stability factor calculation	54
---	----

Annex B (Informative)

B.1 Example of application of Clause 7.10.2.4	55
---	----

Annex C (Informative)

C.1 French translations and markings	56
--	----

Preface

This is the harmonized CSA Group and UL standard for insulated multi-pole splicing wire connectors. It is the first edition of CSA C22.2 No. 2459 and the first edition of UL 2459. This harmonized standard has been jointly revised on September 20, 2018.

This harmonized standard was prepared by the CSA Group and Underwriters Laboratories Inc. (UL). The efforts and support of the Technical Harmonization Committee for Connectors, of the Council on the Harmonization of Electrotechnical Standards of the Nations of the Americas (CANENA), are gratefully acknowledged.

This standard is considered suitable for use for conformity assessment within the stated scope of the standard.

This standard was reviewed by the CSA Integrated Committee on Electrical Connectors, under the jurisdiction of the CSA Technical Committee on Wiring Products and the CSA Strategic Steering Committee on Requirements for Electrical Safety, and has been formally approved by the CSA Technical Committee.

Application of Standard

Where reference is made to a specific number of samples to be tested, the specified number is to be considered a minimum quantity.

Note: Although the intended primary application of this standard is stated in its scope, it is important to note that it remains the responsibility of the users of the standard to judge its suitability for their particular purpose.

Level of harmonization

This standard uses the IEC format but is not based on, nor is it considered equivalent to, an IEC standard.

This standard is published as an equivalent standard for CSA Group and UL.

An equivalent standard is a standard that is substantially the same in technical content, except as follows: Technical national differences are allowed for codes and governmental regulations as well as those recognized as being in accordance with NAFTA Article 905, for example, because of fundamental climatic, geographical, technological, or infrastructural factors, scientific justification, or the level of protection that the country considers appropriate. Presentation is word for word except for editorial changes.

Reasons for differences from IEC

At present there is no IEC standard for insulated multi-pole splicing wire connectors. Therefore, this standard does not employ any IEC standard for base requirements.

Interpretations

The interpretation by the standards development organization of an identical or equivalent standard is based on the literal text to determine compliance with the standard in accordance with the procedural rules of the standards development organization. If more than one interpretation of the literal text has been identified, a revision is to be proposed as soon as possible to each of the standards development organizations to more accurately reflect the intent.

INSULATED MULTI-POLE SPLICING WIRE CONNECTORS

1 Scope

1.1 This Standard covers insulated multi-pole mating or non-mating splicing wire connectors intended for field wiring and factory wiring for use in accordance with the Canadian Electrical Code, Part I, in Canada, and NFPA 70, National Electrical Code, in the United States.

1.2 These wire connectors are intended to facilitate the connection of devices, such as prefabricated wiring assemblies, smoke detectors, and lighting products, to the branch circuit conductors of buildings.

1.2A The dimensions of these connectors are not defined in any national or international technical standard, as such, mating connectors are identified and tested with compatible mating part (or parts, if multiple exist) and are to be of the same manufacturer.

1.3 These requirements also cover luminaire disconnects that are used;

- (a) internal to luminaires to facilitate replacement of the ballast or LED driver, or
- (b) for LED retrofit applications where connected on the line side of the LED driver.

Luminaire disconnects are not to be directly attached to the branch circuit conductors for the purpose of interrupting (making and breaking) branch circuit conductors. Luminaire disconnects may have one or more conductors per contact.

1.4 These wire connectors are suitable for use with 30 to 6 AWG (0.05 to 13.3 mm²) stranded copper conductors and 30 to 10 AWG (0.05 to 5.3 mm²) solid copper conductors.

1.5 These wire connectors are suitable for currents not exceeding the ampacity of insulated conductors or as rated by the manufacturer.

Note: The ampacity of insulated conductors 14 AWG (2.1 mm²) and larger is determined in accordance with the values in the "Assigned maximum ampere rating" column, under the heading "Copper", in Table 7 of CAN/CSA-C22.2 No. 65 or UL 486A-486B. In Canada, the maximum ampacity of insulated conductors 14 AWG (2.1 mm²) and smaller is determined in accordance with Table 12 of the Canadian Electrical Code, Part I.

1.6 These wire connectors are suitable for voltages not exceeding 600 V.

1.7 This Standard does not apply to

- (a) splicing wire connectors intended for direct burial;
- (b) insulated splicing wire connectors intended for use at voltage levels exceeding 600 V (1000 V in a sign or luminaire);
- (c) terminal wire connectors;
- (d) wire binding screw terminals;
- (e) built-in terminal connectors on devices having integral cable clamps;
- (f) flat quick-connect terminals;