

R611.5.5 Construction joints in walls. Construction joints shall be made and located to not impair the strength of the wall. Construction joints in plain concrete walls, including walls required to have not less than No. 4 bars at 48 inches (1219 mm) on center by Section R611.6, shall be located at points of lateral support, and a minimum of one No. 4 bar shall extend across the construction joint at a spacing not to exceed 24 inches (610 mm) on center. Construction joint reinforcement shall have a minimum of 12 inches (305 mm) embedment on both sides of the joint. Construction joints in reinforced concrete walls shall be located in the middle third of the span between lateral supports, or located and constructed as required for joints in plain concrete walls.


Exception: Vertical wall reinforcement required by this code is permitted to be used in lieu of construction joint reinforcement, provided the spacing does not exceed 24 inches (610 mm), or the combination of wall reinforcement and No. 4 bars described above does not exceed 24 inches (610 mm).

R611.6 Above-grade wall requirements.

R611.6.1 General. The minimum thickness of load-bearing and nonload-bearing above-grade walls and reinforcement shall be as set forth in the appropriate table in this section based on the type of wall form to be used. Where the wall or building is not within the limitations of Section R611.2, design is required by the tables in this section, or


the wall is not within the scope of the tables in this section, the wall shall be designed in accordance with ACI 318.

Above-grade concrete walls shall be constructed in accordance with this section and Figure R611.6(1), R611.6(2), R611.6(3) or R611.6(4). Above-grade concrete walls that are continuous with stem walls and not laterally supported by the slab-on-ground shall be designed and constructed in accordance with this section. Concrete walls shall be supported on continuous foundation walls or slabs-on-ground that are monolithic with the footing in accordance with Section R403. The minimum length of solid wall without openings shall be in accordance with Section R611.7. Reinforcement around openings, including lintels, shall be in accordance with Section R611.8. Lateral support for above-grade walls in the out-of-plane direction shall be provided by connections to the floor framing system, if applicable, and to ceiling and roof framing systems in accordance with Section R611.9. The wall thickness shall be equal to or greater than the thickness of the wall in the story above.

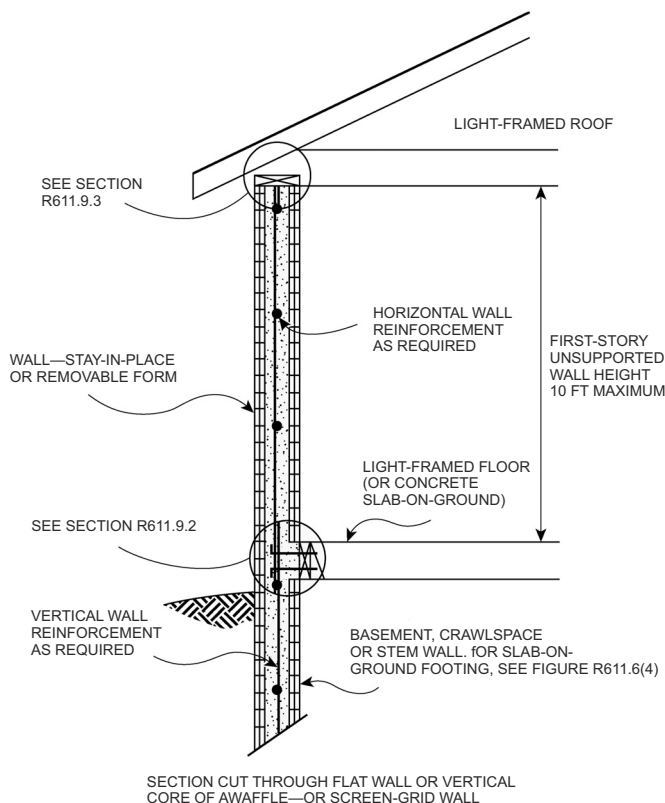

For SI: 1 foot = 304.8 mm.

FIGURE R611.6(1)
ABOVE-GRADE CONCRETE WALL CONSTRUCTION ONE

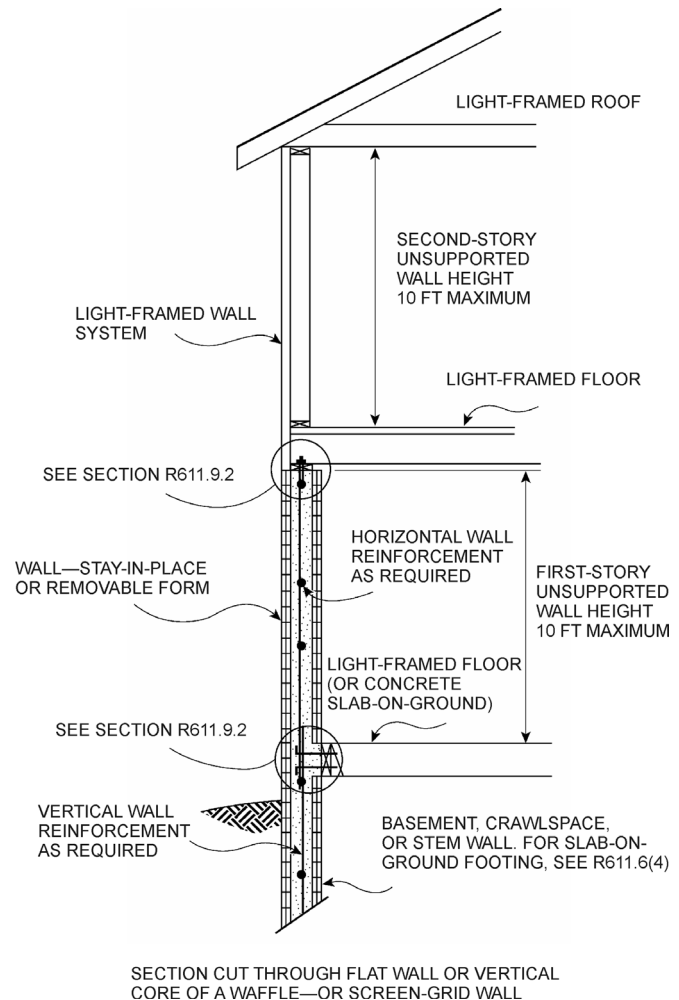

For SI: 1 foot = 304.8 mm.

FIGURE R611.6(2)
ABOVE-GRADE CONCRETE WALL
CONSTRUCTION CONCRETE FIRST-STORY
AND LIGHT-FRAMED SECOND-STORY

R611.6.2 Wall reinforcement for wind. Vertical wall reinforcement for resistance to out-of-plane wind forces shall be determined from Table R611.6(1), R611.6(2), R611.6(3) or R611.6(4). Also, see Sections R611.7.2.2.2 and R611.7.2.2.3. There shall be a vertical bar at all corners of exterior walls. Unless more horizontal reinforcement is required by Section R611.7.2.2.1, the minimum horizontal reinforcement shall be four No. 4 bars [Grade 40 (280 MPa)] placed as follows: top bar within 12 inches (305 mm) of the top of the wall, bottom bar within 12 inches (305 mm) of the finish floor, and one bar each at approximately one-third and two-thirds of the wall height.


R611.6.3 Continuity of wall reinforcement between stories. Vertical reinforcement required by this section shall be continuous between elements providing lateral support for the wall. Reinforcement in the wall of the *story* above shall be continuous with the reinforcement in the wall of the *story* below, or the foundation wall, if applicable. Lap splices, where required, shall comply with Section

R611.5.4.3 and Figure R611.5.4(1). Where the above-grade wall is supported by a monolithic slab-on-ground and footing, dowel bars with a size and spacing to match the vertical above-grade concrete wall reinforcement shall be embedded in the monolithic slab-on-ground and footing in accordance with Section R611.5.4.4 and Figure R611.5.4(2) and lap-spliced with the above-grade wall reinforcement in accordance with Section R611.5.4.3 and Figure R611.5.4(1).

Exception: Where reinforcement in the wall above cannot be made continuous with the reinforcement in the wall below, the bottom of the reinforcement in the wall above shall be terminated in accordance with one of the following:


1. Extend below the top of the floor the distance required to develop the bar in tension in accordance with Section R611.5.4.4 and Figure R611.5.4(2).
2. Lap-spliced in accordance with Section R611.5.4.3 and Figure R611.5.4(1) with a dowel bar that extends into the wall below the distance required to develop the bar in tension in accordance with Section R611.5.4.4 and Figure R611.5.4(2).

Where a construction joint in the wall is located below the level of the floor and less than the distance required to develop the bar in tension, the distance required to develop the bar in tension shall be measured from the top of the concrete below the joint. See Section R611.5.5.

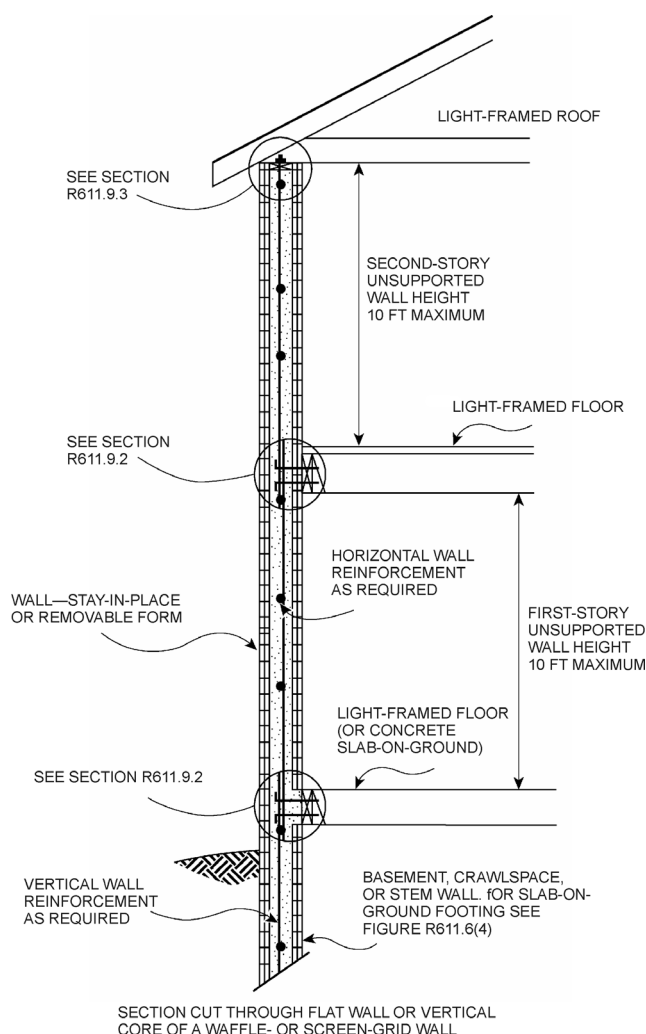

For SI: 1 foot = 304.8 mm.

FIGURE R611.6(3)
ABOVE-GRADE CONCRETE WALL
CONSTRUCTION TWO-STORY

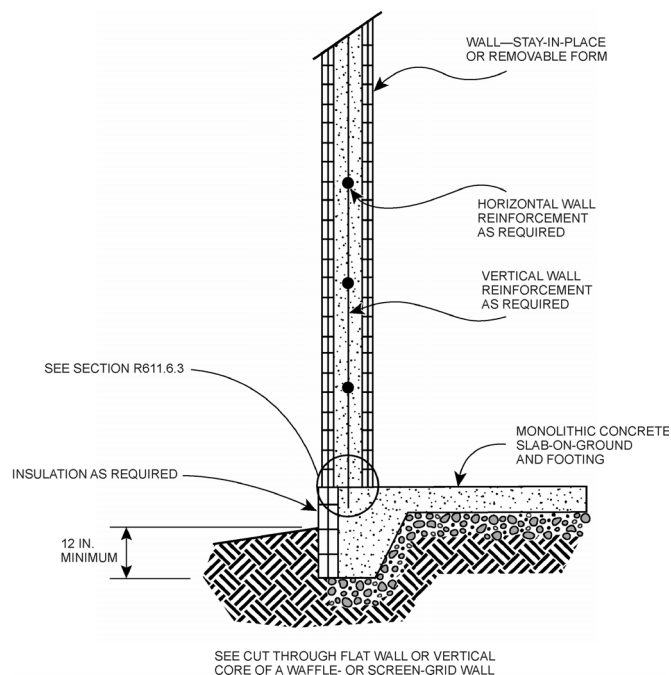

For SI: 1 inch = 25.4 mm.

FIGURE R611.6(4)
ABOVE-GRADE CONCRETE WALL SUPPORTED ON
MONOLITHIC SLAB-ON-GROUND FOOTING

TABLE R611.6(1)
MINIMUM VERTICAL REINFORCEMENT FOR FLAT ABOVE-GRADE WALLS^{a, b, c, d, e}

MAXIMUM WIND SPEED (mph)			MAXIMUM UNSUPPORTED WALL HEIGHT PER STORY (feet)	MINIMUM VERTICAL REINFORCEMENT-BAR SIZE AND SPACING (inches) ^{f, g}								
				Nominal ^h wall thickness (inches)								
Exposure Category				4		6		8		10		
				Top ⁱ	Side ⁱ	Top ⁱ	Side ⁱ	Top ⁱ	Side ⁱ	Top ⁱ	Side ⁱ	
85	—	—	8	4@48	4@48	4@48	4@48	4@48	4@48	4@48	4@48	
			9	4@48	4@43	4@48	4@48	4@48	4@48	4@48	4@48	
			10	4@47	4@36	4@48	4@48	4@48	4@48	4@48	4@48	
90	—	—	8	4@48	4@47	4@48	4@48	4@48	4@48	4@48	4@48	
			9	4@48	4@39	4@48	4@48	4@48	4@48	4@48	4@48	4@48
			10	4@42	4@34	4@48	4@48	4@48	4@48	4@48	4@48	4@48
100	85	—	8	4@48	4@40	4@48	4@48	4@48	4@48	4@48	4@48	
			9	4@42	4@34	4@48	4@48	4@48	4@48	4@48	4@48	4@48
			10	4@34	4@34	4@48	4@48	4@48	4@48	4@48	4@48	4@48
110	90	85	8	4@44	4@34	4@48	4@48	4@48	4@48	4@48	4@48	
			9	4@34	4@34	4@48	4@48	4@48	4@48	4@48	4@48	4@48
			10	4@34	4@31	4@48	4@37	4@48	4@48	4@48	4@48	4@48
120	100	90	8	4@36	4@34	4@48	4@48	4@48	4@48	4@48	4@48	
			9	4@34	4@32	4@48	4@38	4@48	4@48	4@48	4@48	4@48
			10	4@30	4@27	4@48	5@48	4@48	4@48	4@48	4@48	4@48
130	110	100	8	4@34	4@34	4@48	4@48	4@48	4@48	4@48	4@48	
			9	4@32	4@28	4@48	4@33	4@48	4@48	4@48	4@48	4@48
			10	4@26	4@23	4@48	5@43	4@48	4@48	4@48	4@48	4@48

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s, 1 pound per square inch = 1.895 kPa, 1 square foot = 0.0929 m².

- Table is based on ASCE 7 components and cladding wind pressures for an enclosed building using a mean roof height of 35 feet, interior wall area 4, an effective wind area of 10 square feet, and topographic factor, K_z , and importance factor, I , equal to 1.0.
- Table is based on concrete with a minimum specified compressive strength of 2,500 psi.
- See Section R611.6.5 for location of reinforcement in wall.
- Deflection criterion is $L/240$, where L is the unsupported height of the wall in inches.
- Interpolation is not permitted.
- Where No. 4 reinforcing bars at a spacing of 48 inches are specified in the table, use of bars with a minimum yield strength of 40,000 psi or 60,000 psi is permitted.
- Other than for No. 4 bars spaced at 48 inches on center, table values are based on reinforcing bars with a minimum yield strength of 60,000 psi. Vertical reinforcement with a yield strength of less than 60,000 psi and/or bars of a different size than specified in the table are permitted in accordance with Section R611.5.4.7 and Table R611.5.4(2).
- See Table R611.3 for tolerances on nominal thicknesses.
- Top means gravity load from roof and/or floor construction bears on top of wall. Side means gravity load from floor construction is transferred to wall from a wood ledger or cold-formed steel track bolted to side of wall. Where floor framing members span parallel to the wall, use of the top bearing condition is permitted.

TABLE R611.6(2)
MINIMUM VERTICAL REINFORCEMENT FOR WAFFLE-GRID ABOVE-GRADE WALLS^{a, b, c, d, e}

MAXIMUM WIND SPEED (mph)			MAXIMUM UNSUPPORTED WALL HEIGHT PER STORY (feet)	MINIMUM VERTICAL REINFORCEMENT-BAR SIZE AND SPACING (inches) ^{f, g}			
				Nominal ^h wall thickness (inches)			
Exposure Category				6		8	
				Top ⁱ	Side ⁱ	Top ⁱ	Side ⁱ
B	C	D					
85	—	—	8	4@48	4@36, 5@48	4@48	4@48
			9	4@48	4@30, 5@47	4@48	4@45
			10	4@48	4@26, 5@40	4@48	4@39
90	—	—	8	4@48	4@33, 5@48	4@48	4@48
			9	4@48	4@28, 5@43	4@48	4@42
			10	4@31, 5@48	4@24, 5@37	4@48	4@36
100	85	—	8	4@48	4@28, 5@44	4@48	4@43
			9	4@31, 5@48	4@24, 5@37	4@48	4@36
			10	4@25, 5@39	4@24, 5@37	4@48	4@31, 5@48
110	90	85	8	4@33, 5@48	4@25, 5@38	4@48	4@38
			9	4@26, 5@40	4@24, 5@37	4@48	4@31, 5@48
			10	4@24, 5@37	4@23, 5@35	4@48	4@27, 5@41
120	100	90	8	4@27, 5@42	4@24, 5@37	4@48	4@33, 5@48
			9	4@24, 5@37	4@23, 5@36	4@48	4@27, 5@43
			10	4@23, 5@35	4@19, 5@30	4@48	4@23, 5@36
130	110	100	8	4@24, 5@37	4@24, 5@37	4@48	4@29, 5@45
			9	4@24, 5@37	4@20, 5@32	4@48	4@24, 5@37
			10	4@19, 5@30	4@17, 5@26	4@23, 5@36	4@20, 5@31

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s, 1 pound per square inch = 6.895 kPa, 1 square foot = 0.0929 m².

- Table is based on ASCE 7 components and cladding wind pressures for an enclosed building using a mean roof height of 35 feet, interior wall area 4, an effective wind area of 10 square feet, and topographic factor, K_z , and importance factor, I , equal to 1.0.
- Table is based on concrete with a minimum specified compressive strength of 2,500 psi.
- See Section R611.6.5 for location of reinforcement in wall.
- Deflection criterion is $L/240$, where L is the unsupported height of the wall in inches.
- Interpolation is not permitted.
- Where No. 4 reinforcing bars at a spacing of 48 inches are specified in the table, use of bars with a minimum yield strength of 40,000 psi or 60,000 psi is permitted.
- Other than for No. 4 bars spaced at 48 inches on center, table values are based on reinforcing bars with a minimum yield strength of 60,000 psi. Maximum spacings shown are the values calculated for the specified bar size. Where the bar used is Grade 60 and the size specified in the table, the actual spacing in the wall shall not exceed a whole-number multiple of 12 inches (i.e., 12, 24, 36 and 48) that is less than or equal to the tabulated spacing. Vertical reinforcement with a yield strength of less than 60,000 psi and/or bars of a different size than specified in the table are permitted in accordance with Section R611.5.4.7 and Table R611.5.4(2).
- See Table R611.3 for minimum core dimensions and maximum spacing of horizontal and vertical cores.
- Top means gravity load from roof and/or floor construction bears on top of wall. Side means gravity load from floor construction is transferred to wall from a wood ledger or cold-formed steel track bolted to side of wall. Where floor framing members span parallel to the wall, the top bearing condition is permitted to be used.

TABLE R611.6(3)
MINIMUM VERTICAL REINFORCEMENT FOR 6-INCH SCREEN-GRID ABOVE-GRADE WALLS^{a, b, c, d, e}

MAXIMUM WIND SPEED (mph)			MAXIMUM UNSUPPORTED WALL HEIGHT PER STORY (feet)	MINIMUM VERTICAL REINFORCEMENT-BAR SIZE AND SPACING (inches) ^{f, g}	
				Nominal ^h wall thickness (inches)	
Exposure Category				6	
				Top ⁱ	Side ⁱ
B	C	D			
85	—	—	8	4@48	4@34, 5@48
			9	4@48	4@29, 5@45
			10	4@48	4@25, 5@39
90	—	—	8	4@48	4@31, 5@48
			9	4@48	4@27, 5@41
			10	4@30, 5@47	4@23, 5@35
100	85	—	8	4@48	4@27, 5@42
			9	4@30, 5@47	4@23, 5@35
			10	4@24, 5@38	4@22, 5@34
110	90	85	8	4@48	4@24, 5@37
			9	4@25, 5@38	4@22, 5@34
			10	4@22, 5@34	4@22, 5@34
120	100	90	8	4@26, 5@41	4@22, 5@34
			9	4@22, 5@34	4@22, 5@34
			10	4@22, 6@34	4@19, 5@26
130	110	100	8	4@22, 5@35	4@22, 5@34
			9	4@22, 5@34	4@20, 5@30
			10	4@19, 5@29	4@16, 5@25

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s, 1 pound per square inch = 6.895 kPa, 1 square foot = 0.0929 m².

- Table is based on ASCE 7 components and cladding wind pressures for an enclosed building using a mean roof height of 35 feet, interior wall area 4, an effective wind area of 10 square feet, and topographic factor, K_z , and importance factor, I , equal to 1.0.
- Table is based on concrete with a minimum specified compressive strength of 2,500 psi.
- See Section R611.6.5 for location of reinforcement in wall.
- Deflection criterion is $L/240$, where L is the unsupported height of the wall in inches.
- Interpolation is not permitted.
- Where No. 4 reinforcing bars at a spacing of 48 inches are specified in the table, use of bars with a minimum yield strength of 40,000 psi or 60,000 psi is permitted.
- Other than for No. 4 bars spaced at 48 inches on center, table values are based on reinforcing bars with a minimum yield strength of 60,000 psi. Maximum spacings shown are the values calculated for the specified bar size. Where the bar used is Grade 60 and the size specified in the table, the actual spacing in the wall shall not exceed a whole-number multiple of 12 inches (i.e., 12, 24, 36 and 48) that is less than or equal to the tabulated spacing. Vertical reinforcement with a yield strength of less than 60,000 psi and/or bars of a different size than specified in the table are permitted in accordance with Section R611.5.4.7 and Table R611.5.4(2).
- See Table R611.3 for minimum core dimensions and maximum spacing of horizontal and vertical cores.
- Top means gravity load from roof and/or floor construction bears on top of wall. Side means gravity load from floor construction is transferred to wall from a wood ledger or cold-formed steel track bolted to side of wall. Where floor framing members span parallel to the wall, use of the top bearing condition is permitted.

TABLE R611.6(4)
MINIMUM VERTICAL REINFORCEMENT FOR FLAT, WAFFLE- AND SCREEN-GRID
ABOVE-GRADE WALLS DESIGNED CONTINUOUS WITH FOUNDATION STEM WALLS^{a, b, c, d, e, k, l}

MAXIMUM WIND SPEED (mph)			HEIGHT OF STEM WALL ^{h, i} (feet)	MAXIMUM DESIGN LATERAL SOIL LOAD (psf/ft)	MAXIMUM UNSUPPORTED HEIGHT OF ABOVE- GRADE WALL (feet)	MINIMUM VERTICAL REINFORCEMENT-BAR SIZE AND SPACING (inches) ^{f, g}						
						Wall type and nominal thickness ^l (inches)						
Exposure Category						Flat				Waffle		Screen
						4	6	8	10	6	8	6
85	—	—	3	30	8	4@33	4@39	4@48	4@48	4@24	4@28	4@22
					10	4@26	5@48	4@41	4@48	4@19	4@22	4@18
				60	10	4@21	5@40	5@48	4@44	4@16	4@19	4@15
			6	30	10	DR	5@22	6@35	6@43	DR	4@11	DR
				60	10	DR	DR	6@26	6@28	DR	DR	DR
90	—	—	3	30	8	4@30	4@36	4@48	4@48	4@22	4@26	4@21
					10	4@24	5@44	4@38	4@48	4@17	4@21	4@17
				60	10	4@20	5@37	4@48	4@41	4@15	4@18	4@14
			6	30	10	DR	5@21	6@35	6@41	DR	4@10	DR
				60	10	DR	DR	6@26	6@28	DR	DR	DR
100	85	—	3	30	8	4@26	5@48	4@42	4@48	4@19	4@23	4@18
					10	4@20	5@37	4@33	4@41	4@15	4@18	4@14
			6	60	10	4@17	5@34	5@44	4@36	4@13	4@17	4@12
				30	10	DR	5@20	6@35	6@38	DR	4@9	DR
				60	10	DR	DR	6@24	6@28	DR	DR	DR
110	90	85	3	30	8	4@22	5@42	4@37	4@46	4@16	4@20	4@16
					10	4@17	5@34	5@44	4@35	4@12	4@17	4@12
				60	10	4@15	5@34	5@39	5@48	4@11	4@17	4@11
			6	30	10	DR	5@18	6@35	6@35	DR	4@9	DR
				60	10	DR	DR	6@23	6@28	DR	DR	DR
120	100	90	3	30	8	4@19	5@37	5@48	4@40	4@14	4@17	4@14
					10	4@14	5@34	5@38	5@48	4@11	4@17	4@10
				60	10	4@13	5@33	6@48	5@43	4@10	4@16	4@9
			6	30	10	DR	5@16	6@33	6@32	DR	4@8	DR
				60	10	DR	DR	6@22	6@28	DR	DR	DR
130	110	100	3	30	8	4@17	5@34	5@44	4@36	4@12	4@17	4@10
					10	DR	5@32	6@47	5@42	4@9	4@15	DR
				60	10	DR	5@29	6@43	5@39	DR	4@14	DR
			6	30	10	DR	5@15	6@30	6@29	DR	4@7	DR
				60	10	DR	DR	6@21	6@27	DR	DR	DR

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s, 1 pound per square inch = 6.895 kPa, 1 square foot = 0.0929 m².

- Table is based on ASCE 7 components and cladding wind pressures for an enclosed building using a mean roof height of 35 feet, interior wall area 4, an effective wind area of 10 square feet, and topographic factor, K_{zt} , and importance factor, I , equal to 1.0.
- Table is based on concrete with a minimum specified compressive strength of 2,500 psi.
- See Section R611.6.5 for location of reinforcement in wall.
- Deflection criterion is $L/240$, where L is the height of the wall in inches from the exterior finish ground level to the top of the above-grade wall.
- Interpolation is not permitted. For intermediate values of basic wind speed, heights of stem wall and above-grade wall, and design lateral soil load, use next higher value.
- Where No. 4 reinforcing bars at a spacing of 48 inches are specified in the table, use of bars with a minimum yield strength of 40,000 psi or 60,000 psi is permitted.
- Other than for No. 4 bars spaced at 48 inches on center, table values are based on reinforcing bars with a minimum yield strength of 60,000 psi. Maximum spacings shown are the values calculated for the specified bar size. In waffle and screen-grid walls where the bar used is Grade 60 and the size specified in the table, the actual spacing in the wall shall not exceed a whole-number multiple of 12 inches (i.e., 12, 24, 36 and 48) that is less than or equal to the tabulated spacing. Vertical reinforcement with a yield strength of less than 60,000 psi and/or bars of a different size than specified in the table are permitted in accordance with Section R611.5.4.7 and Table R611.5.4(2).
- Height of stem wall is the distance from the exterior finish ground level to the top of the slab-on-ground.
- Where the distance from the exterior finish ground level to the top of the slab-on-ground is equal to or greater than 4 feet, the stem wall shall be laterally supported at the top and bottom before backfilling. Where the wall is designed and constructed to be continuous with the above-grade wall, temporary supports bracing the top of the stem wall shall remain in place until the above-grade wall is laterally supported at the top by floor or roof construction.
- See Table R611.3 for tolerances on nominal thicknesses, and minimum core dimensions and maximum spacing of horizontal and vertical cores for waffle- and screen-grid walls.
- Tabulated values are applicable to construction where gravity loads bear on top of wall, and conditions where gravity loads from floor construction are transferred to wall from a wood ledger or cold-formed steel track bolted to side of wall. See Tables R611.6(1), R611.6(2) and R611.6(3).
- DR indicates design required.

R611.6.4 Termination of reinforcement. Where indicated in Items 1 through 3, vertical wall reinforcement in the top-most *story* with concrete walls shall be terminated with a 90-degree (1.57 rad) standard hook complying with Section R611.5.4.5 and Figure R611.5.4(3).

1. Vertical bars adjacent to door and window openings required by Section R611.8.1.2.
2. Vertical bars at the ends of required solid wall segments. See Section R611.7.2.2.2.
3. Vertical bars (other than end bars, see Item 2) used as shear reinforcement in required solid wall segments where the reduction factor for design strength, R_3 , used is based on the wall having horizontal and vertical shear reinforcement. See Section R611.7.2.2.3.

The bar extension of the hook shall be oriented parallel to the horizontal wall reinforcement and be within 4 inches (102 mm) of the top of the wall.

Horizontal reinforcement shall be continuous around the building corners by bending one of the bars and lap-splicing it with the bar in the other wall in accordance with Section R611.5.4.3 and Figure R611.5.4(1).

Exception: In lieu of bending horizontal reinforcement at corners, separate bent reinforcing bars shall be permitted provided that the bent bar is lap-spliced with the horizontal reinforcement in both walls in accordance with Section R611.5.4.3 and Figure R611.5.4(1).

In required solid wall segments where the reduction factor for design strength, R_3 , is based on the wall having horizontal and vertical shear reinforcement in accordance with Section R611.7.2.2.1, horizontal wall reinforcement shall be terminated with a standard hook complying with Section R611.5.4.5 and Figure R611.5.4(3) or in a lap-splice, except at corners where the reinforcement shall be continuous as required above.

R611.6.5 Location of reinforcement in wall. Except for vertical reinforcement at the ends of required solid wall segments, which shall be located as required by Section R611.7.2.2.2, the location of the vertical reinforcement shall not vary from the center of the wall by more than the greater of 10 percent of the wall thickness and $\frac{3}{8}$ -inch (10 mm). Horizontal and vertical reinforcement shall be located to provide not less than the minimum cover required by Section R611.5.4.1.

R611.7 Solid walls for resistance to lateral forces.

R611.7.1 Length of solid wall. Each exterior wall line in each *story* shall have a total length of solid wall required by Section R611.7.1.1. A solid wall is a section of flat, waffle-grid or screen-grid wall, extending the full *story height* without openings or penetrations, except those permitted by Section R611.7.2. Solid wall segments that contribute to the total length of solid wall shall comply with Section R611.7.2.

R611.7.1.1 Length of solid wall for wind. All buildings shall have solid walls in each exterior endwall line (the side of a building that is parallel to the span of the roof or floor framing) and sidewall line (the side of a building that is perpendicular to the span of the roof or floor framing) to resist lateral in-plane wind forces. The site-appropriate basic wind speed and exposure category shall be used in Tables R611.7(1A) through (1C) to determine the unreduced total length, UR , of solid wall required in each exterior endwall line and sidewall line. For buildings with a mean roof height of less than 35 feet (10 668 mm), the unreduced values determined from Tables R611.7(1A) through (1C) is permitted by multiplying by the applicable factor, R_1 , from Table R611.7(2); however, reduced values shall not be less than the minimum values in Tables R611.7(1A) through (1C). Where the floor-to-ceiling height of a *story* is less than 10 feet (3048 mm), the unreduced values determined from Tables R611.7(1A) through (1C), including minimum values, is permitted to be reduced by multiplying by the applicable factor, R_2 , from Table R611.7(3). To account for different design strengths than assumed in determining the values in Tables R611.7(1A) through (1C), the unreduced lengths determined from Tables R611.7(1A) through (1C), including minimum values, are permitted to be reduced by multiplying by the applicable factor, R_3 , from Table R611.7(4). The reductions permitted by Tables R611.7(2), R611.7(3) and R611.7(4) are cumulative.

The total length of solid wall segments, TL , in a wall line that comply with the minimum length requirements of Section R611.7.2.1 [see Figure R611.7(1)] shall be equal to or greater than the product of the unreduced length of solid wall from Tables R611.7(1A) through (1C), UR and the applicable reduction factors, if any, from Tables R611.7(2), R611.7(3) and R611.7(4) as indicated by Equation R6-1.

$$TL \geq R_1 \cdot R_2 \cdot R_3 \cdot UR \quad \text{(Equation R6-1)}$$

where:

TL = Total length of solid wall segments in a wall line that comply with Section R611.7.2.1 [see Figure R611.7(1)];

R_1 = 1.0 or reduction factor for mean roof height from Table R611.7(2);

R_2 = 1.0 or reduction factor for floor-to-ceiling wall height from Table R611.7(3);

R_3 = 1.0 or reduction factor for design strength from Table R611.7(4), and

UR = Unreduced length of solid wall from Tables R611.7(1A) through (1C).

The total length of solid wall in a wall line, TL , shall not be less than that provided by two solid wall segments complying with the minimum length requirements of Section R611.7.2.1.

To facilitate determining the required wall thickness, wall type, number and *grade* of vertical bars at the each end of each solid wall segment, and whether shear reinforcement is required, use of Equation R6-2 is permitted.

$$R \leq \frac{TL}{R_1 \cdot R_2 \cdot UR} \quad (\text{Equation R6-2})$$

After determining the maximum permitted value of the reduction factor for design strength, R_3 , in accordance with Equation R6-2, select a wall type from Table R611.7(4) with R_3 less than or equal to the value calculated.

TABLE R611.7(1A)
UNREDUCED LENGTH, UR , OF SOLID WALL REQUIRED IN EACH EXTERIOR ENDWALL
FOR WIND PERPENDICULAR TO RIDGE ONE STORY OR TOP STORY OF TWO STORY^{a, c, d, e, f, g}

SIDEWALL LENGTH (feet)	ENDWALL LENGTH (feet)	ROOF SLOPE	UNREDUCED LENGTH, UR , OF SOLID WALL REQUIRED IN ENDWALLS FOR WIND PERPENDICULAR TO RIDGE (feet)						
			Basic Wind Speed (mph) Exposure						Minimum ^b
			85B	90B	100B	110B	120B	130B	
					85C	90C	100C	110C	
						85D	90D	100D	
15	15	< 1:12	0.90	1.01	1.25	1.51	1.80	2.11	0.98
		5:12	1.25	1.40	1.73	2.09	2.49	2.92	1.43
		7:12	1.75	1.96	2.43	2.93	3.49	4.10	1.64
		12:12	2.80	3.13	3.87	4.68	5.57	6.54	2.21
	30	< 1:12	0.90	1.01	1.25	1.51	1.80	2.11	1.09
		5:12	1.25	1.40	1.73	2.09	2.49	2.92	2.01
		7:12	2.43	2.73	3.37	4.08	4.85	5.69	2.42
		12:12	4.52	5.07	6.27	7.57	9.01	10.58	3.57
	45	< 1:12	0.90	1.01	1.25	1.51	1.80	2.11	1.21
		5:12	1.25	1.40	1.73	2.09	2.49	2.92	2.59
		7:12	3.12	3.49	4.32	5.22	6.21	7.29	3.21
		12:12	6.25	7.00	8.66	10.47	12.45	14.61	4.93
	60	< 1:12	0.90	1.01	1.25	1.51	1.80	2.11	1.33
		5:12	1.25	1.40	1.73	2.09	2.49	2.92	3.16
		7:12	3.80	4.26	5.26	6.36	7.57	8.89	3.99
		12:12	7.97	8.94	11.05	13.36	15.89	18.65	6.29
30	15	< 1:12	1.61	1.80	2.23	2.70	3.21	3.77	1.93
		5:12	2.24	2.51	3.10	3.74	4.45	5.23	2.75
		7:12	3.15	3.53	4.37	5.28	6.28	7.37	3.12
		12:12	4.90	5.49	6.79	8.21	9.77	11.46	4.14
	30	< 1:12	1.61	1.80	2.23	2.70	3.21	3.77	2.14
		5:12	2.24	2.51	3.10	3.74	4.45	5.23	3.78
		7:12	4.30	4.82	5.96	7.20	8.57	10.05	4.52
		12:12	7.79	8.74	10.80	13.06	15.53	18.23	6.57
	45	< 1:12	1.61	1.80	2.23	2.70	3.21	3.77	2.35
		5:12	2.24	2.51	3.10	3.74	4.45	5.23	4.81
		7:12	5.44	6.10	7.54	9.12	10.85	12.73	5.92
		12:12	10.69	11.98	14.81	17.90	21.30	25.00	9.00
	60	< 1:12	1.61	1.80	2.23	2.70	3.21	3.77	2.56
		5:12	2.24	2.51	3.10	3.74	4.45	5.23	5.84
		7:12	6.59	7.39	9.13	11.04	13.14	15.41	7.32
		12:12	13.58	15.22	18.82	22.75	27.07	31.77	11.43

(continued)

WALL CONSTRUCTION

TABLE R611.7(1A)—continued
UNREDUCED LENGTH, UR, OF SOLID WALL REQUIRED IN EACH EXTERIOR ENDWALL
FOR WIND PERPENDICULAR TO RIDGE ONE STORY OR TOP STORY OF TWO STORY^{a, c, d, e, f, g}

SIDEWALL LENGTH (feet)	ENDWALL LENGTH (feet)	ROOF SLOPE	UNREDUCED LENGTH, UR, OF SOLID WALL REQUIRED IN ENDWALLS FOR WIND PERPENDICULAR TO RIDGE (feet)						
			Basic Wind Speed (mph) Exposure						Minimum ^b
			85B	90B	100B	110B	120B	130B	
					85C	90C	100C	110C	
						85D	90D	100D	
60	15	< 1:12	2.99	3.35	4.14	5.00	5.95	6.98	3.83
		5:12	4.15	4.65	5.75	6.95	8.27	9.70	5.37
		7:12	5.91	6.63	8.19	9.90	11.78	13.83	6.07
		12:12	9.05	10.14	12.54	15.16	18.03	21.16	8.00
	30	< 1:12	2.99	3.35	4.14	5.00	5.95	6.98	4.23
		5:12	4.15	4.65	5.75	6.95	8.27	9.70	7.31
		7:12	7.97	8.94	11.05	13.36	15.89	18.65	8.71
		12:12	14.25	15.97	19.74	23.86	28.40	33.32	12.57
	45	< 1:12	3.11	3.48	4.30	5.20	6.19	7.26	4.63
		5:12	4.31	4.84	5.98	7.23	8.60	10.09	9.25
		7:12	10.24	11.47	14.19	17.15	20.40	23.84	11.35
		12:12	19.84	22.24	27.49	33.23	39.54	46.40	17.14
	60	< 1:12	3.22	3.61	4.46	5.39	6.42	7.53	5.03
		5:12	4.47	5.01	6.19	7.49	8.91	10.46	11.19
		7:12	12.57	14.09	17.42	21.05	25.05	29.39	13.99
		12:12	25.61	28.70	35.49	42.90	51.04	59.90	21.71

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s, 1 pound-force per linear foot = 0.146 kN/m, 1 pound per square foot = 47.88 Pa.

- Tabulated lengths were derived by calculating design wind pressures in accordance with Figure 6-10 of ASCE 7 for a building with a mean roof height of 35 feet. For wind perpendicular to the ridge, the effects of a 2-foot overhang on each endwall are included. The design pressures were used to calculate forces to be resisted by solid wall segments in each endwall [Table R611.7(1A) or R611.7(1B) or sidewall (Table R611.7(1C))], as appropriate. The forces to be resisted by each wall line were then divided by the default design strength of 840 pounds per linear foot of length to determine the required solid wall length. The actual mean roof height of the building shall not exceed the least horizontal dimension of the building.
- Tabulated lengths in the “minimum” column are based on the requirement of Section 6.1.4.1 of ASCE 7 that the main windforce-resisting system be designed for a minimum service level force of 10 psf multiplied by the area of the building projected onto a vertical plane normal to the assumed wind direction. Tabulated lengths in shaded cells are less than the “minimum” value. Where the minimum controls, it is permitted to be reduced in accordance with Notes c, d and e. See Section R611.7.1.1.
- For buildings with a mean roof height of less than 35 feet, tabulated lengths are permitted to be reduced by multiplying by the appropriate factor, R_1 , from Table R611.7(2). The reduced length shall not be less than the “minimum” value shown in the table.
- Tabulated lengths for “one story or top story of two story” are based on a floor-to-ceiling height of 10 feet. Tabulated lengths for “first story of two story” are based on floor-to-ceiling heights of 10 feet each for the first and second story. For floor-to-ceiling heights less than assumed, use the lengths in Table R611.7(1A), (1B) or (1C), or multiply the value in the table by the reduction factor, R_2 , from Table R611.7(3).
- Tabulated lengths are based on the default design shear strength of 840 pounds per linear foot of solid wall segment. The tabulated lengths are permitted to be reduced by multiplying by the applicable reduction factor for design strength, R_3 , from Table R611.7(4).
- The reduction factors, R_1 , R_2 and R_3 , in Tables R611.7(2), R611.7(3), and R611.7(4), respectively, are permitted to be compounded, subject to the limitations of Note b. However, the minimum number and minimum length of solid walls segments in each wall line shall comply with Sections R611.7.1 and R611.7.2.1, respectively.
- For intermediate values of sidewall length, endwall length, roof slope and basic wind speed, use the next higher value, or determine by interpolation.

TABLE R611.7(1B)
UNREDUCED LENGTH, U_R , OF SOLID WALL REQUIRED IN EACH EXTERIOR ENDWALL
FOR WIND PERPENDICULAR TO RIDGE FIRST STORY OF TWO STORY^{a, c, d, e, f, g}

SIDEWALL LENGTH (feet)	ENDWALL LENGTH (feet)	ROOF SLOPE	UNREDUCED LENGTH, <i>U_R</i> , OF SOLID WALL REQUIRED IN ENDWALLS FOR WIND PERPENDICULAR TO RIDGE (feet)						
			Basic Wind Speed (mph) Exposure						
			85B	90B	100B	110B	120B	130B	Minimum ^b
					85C	90C	100C	110C	
						85D	90D	100D	
			Velocity pressure (psf)						
11.51	12.90	15.95	19.28	22.94	26.92				
15	15	< 1:12	2.60	2.92	3.61	4.36	5.19	6.09	2.59
		5:12	3.61	4.05	5.00	6.05	7.20	8.45	3.05
		7:12	3.77	4.23	5.23	6.32	7.52	8.82	3.26
		12:12	4.81	5.40	6.67	8.06	9.60	11.26	3.83
	30	< 1:12	2.60	2.92	3.61	4.36	5.19	6.09	2.71
		5:12	3.61	4.05	5.00	6.05	7.20	8.45	3.63
		7:12	4.45	4.99	6.17	7.46	8.88	10.42	4.04
		12:12	6.54	7.33	9.06	10.96	13.04	15.30	5.19
	45	< 1:12	2.60	2.92	3.61	4.36	5.19	6.09	2.83
		5:12	3.61	4.05	5.00	6.05	7.20	8.45	4.20
		7:12	5.14	5.76	7.12	8.60	10.24	12.01	4.83
		12:12	8.27	9.27	11.46	13.85	16.48	19.34	6.55
	60	< 1:12	2.60	2.92	3.61	4.36	5.19	6.09	2.95
		5:12	3.61	4.05	5.00	6.05	7.20	8.45	4.78
		7:12	5.82	6.52	8.06	9.75	11.60	13.61	5.61
		12:12	9.99	11.20	13.85	16.74	19.92	23.37	7.90
30	15	< 1:12	4.65	5.21	6.45	7.79	9.27	10.88	5.16
		5:12	6.46	7.24	8.95	10.82	12.87	15.10	5.98
		7:12	6.94	7.78	9.62	11.62	13.83	16.23	6.35
		12:12	8.69	9.74	12.04	14.55	17.32	20.32	7.38
	30	< 1:12	4.65	5.21	6.45	7.79	9.27	10.88	5.38
		5:12	6.46	7.24	8.95	10.82	12.87	15.10	7.01
		7:12	8.09	9.06	11.21	13.54	16.12	18.91	7.76
		12:12	11.58	12.98	16.05	19.40	23.08	27.09	9.81
	45	< 1:12	4.65	5.21	6.45	7.79	9.27	10.88	5.59
		5:12	6.46	7.24	8.95	10.82	12.87	15.10	8.04
		7:12	9.23	10.35	12.79	15.46	18.40	21.59	9.16
		12:12	14.48	16.22	20.06	24.25	28.85	33.86	12.24
	60	< 1:12	4.65	5.21	6.45	7.79	9.27	10.88	5.80
		5:12	6.46	7.24	8.95	10.82	12.87	15.10	9.08
		7:12	10.38	11.63	14.38	17.38	20.69	24.27	10.56
		12:12	17.37	19.47	24.07	29.10	34.62	40.63	14.67

(continued)

TABLE R611.7(1B)—continued
UNREDUCED LENGTH, U_R , OF SOLID WALL REQUIRED IN EACH EXTERIOR ENDWALL
FOR WIND PERPENDICULAR TO RIDGE FIRST STORY OF TWO STORY^{a, c, d, e, f, g}

SIDEWALL LENGTH (feet)	ENDWALL LENGTH (feet)	ROOF SLOPE	UNREDUCED LENGTH, <i>U_R</i> , OF SOLID WALL REQUIRED IN ENDWALLS FOR WIND PERPENDICULAR TO RIDGE (feet)						
			Basic Wind Speed (mph) Exposure						Minimum ^b
			85B	90B	100B	110B	120B	130B	
					85C	90C	100C	110C	
						85D	90D	100D	
			Velocity pressure (psf)						
		11.51	12.90	15.95	19.28	22.94	26.92		
60	15	< 1:12	8.62	9.67	11.95	14.45	17.19	20.17	10.30
		5:12	11.98	13.43	16.61	20.07	23.88	28.03	11.85
		7:12	13.18	14.78	18.27	22.08	26.28	30.83	12.54
		12:12	16.32	18.29	22.62	27.34	32.53	38.17	14.48
	30	< 1:12	8.62	9.67	11.95	14.45	17.19	20.17	10.70
		5:12	11.98	13.43	16.61	20.07	23.88	28.03	13.79
		7:12	15.25	17.09	21.13	25.54	30.38	35.66	15.18
		12:12	21.52	24.12	29.82	36.05	42.89	50.33	19.05
	45	< 1:12	8.97	10.06	12.43	15.03	17.88	20.99	11.10
		5:12	12.46	13.97	17.27	20.88	24.84	29.15	15.73
		7:12	17.67	19.80	24.48	29.59	35.21	41.32	17.82
		12:12	27.27	30.56	37.79	45.68	54.35	63.78	23.62
	60	< 1:12	9.30	10.43	12.89	15.58	18.54	21.76	11.50
		5:12	12.91	14.47	17.90	21.63	25.74	30.20	17.67
		7:12	20.14	22.58	27.91	33.74	40.15	47.11	20.46
		12:12	33.19	37.19	45.99	55.59	66.14	77.62	28.19

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s, 1 pound force per linear foot = 0.146 kN/m, 1 pound per square foot = 47.88 Pa.

- Tabulated lengths were derived by calculating design wind pressures in accordance with Figure 6-10 of ASCE 7 for a building with a mean roof height of 35 feet. For wind perpendicular to the ridge, the effects of a 2-foot overhang on each endwall are included. The design pressures were used to calculate forces to be resisted by solid wall segments in each endwall [Table R611.7(1A) or R611.7(1B)] or sidewall [Table R611.7(1C)], as appropriate. The forces to be resisted by each wall line were then divided by the default design strength of 840 pounds per linear foot of length to determine the required solid wall length. The actual mean roof height of the building shall not exceed the least horizontal dimension of the building.
- Tabulated lengths in the “minimum” column are based on the requirement of Section 6.1.4.1 of ASCE 7 that the main windforce-resisting system be designed for a minimum service level force of 10 psf multiplied by the area of the building projected onto a vertical plane normal to the assumed wind direction. Tabulated lengths in shaded cells are less than the “minimum” value. Where the minimum controls, it is permitted to be reduced in accordance with Notes c, d and e. See Section R611.7.1.1.
- For buildings with a mean roof height of less than 35 feet, tabulated lengths are permitted to be reduced by multiplying by the appropriate factor, R_1 , from Table R611.7(2). The reduced length shall not be less than the “minimum” value shown in the table.
- Tabulated lengths for “one story or top story of two story” are based on a floor-to-ceiling height of 10 feet. Tabulated lengths for “first story of two story” are based on floor-to-ceiling heights of 10 feet each for the first and second story. For floor-to-ceiling heights less than assumed, use the lengths in Table R611.7(1A), (1B) or (1C), or multiply the value in the table by the reduction factor, R_2 , from Table R611.7(3).
- Tabulated lengths are based on the default design shear strength of 840 pounds per linear foot of solid wall segment. The tabulated lengths are permitted to be reduced by multiplying by the applicable reduction factor for design strength, R_3 , from Table R611.7(4).
- The reduction factors, R_1 , R_2 and R_3 , in Tables R611.7(2), R611.7(3), and R611.7(4), respectively, are permitted to be compounded, subject to the limitations of Note b. However, the minimum number and minimum length of solid walls segments in each wall line shall comply with Sections R611.7.1 and R611.7.2.1, respectively.
- For intermediate values of sidewall length, endwall length, roof slope and basic wind speed, use the next higher value, or determine by interpolation.